

PRIVATE SEWAGE DISPOSAL SYSTEM

METROPOLITAN HEALTH DEPARTMENT

Address LOT 47 ST. JAMES DR.

311-23rd Avenue, North
Nashville, Tennessee 37203

Owner MR. RON HUNTER.

Division of Public Health Engineering

CHICKERING ESTATES-SECTION 2


Property Map 144-9 Parcel 22

Minimum requirements for approval for the installation, alteration, or repair of septic tank-soil absorption system at the above address. Install 330 square feet of disposal field (per bedroom) in area indicated. This installation must comply with the Metropolitan Plumbing Code. New overflows are to follow existing ground contours.

If so indicated, this installation will require: ☐ Switch box and tight line ☒ AS PER CODE Gallon septic tank ☐ Sump pump and baffle box.
This installation for: ☐ Repair to existing system ☒ New dwelling or alteration to existing dwelling.

TO: METROPOLITAN CODES ADMINISTRATION
FROM: METROPOLITAN HEALTH DEPARTMENT

DATE: 9-17-79

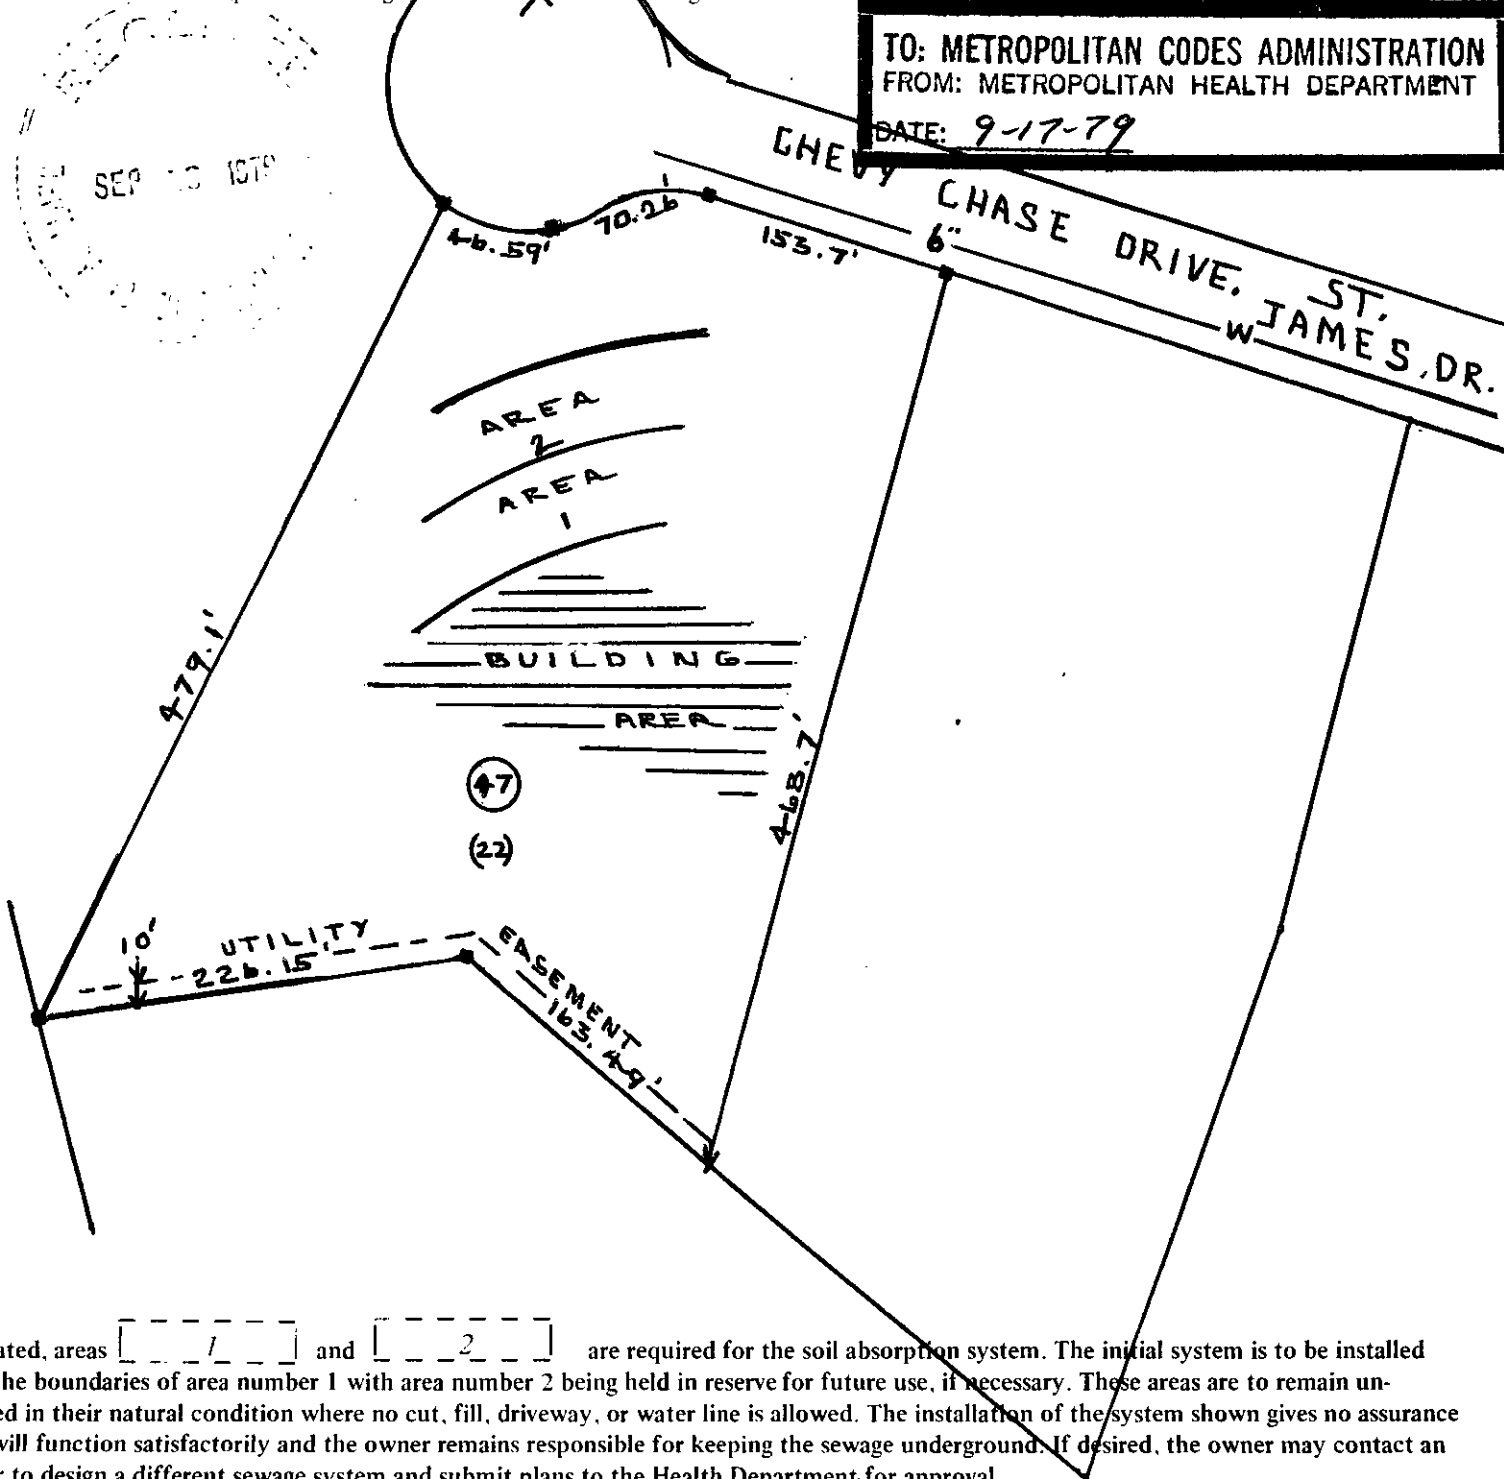

If indicated, areas 1 and 2 are required for the soil absorption system. The initial system is to be installed within the boundaries of area number 1 with area number 2 being held in reserve for future use, if necessary. These areas are to remain undisturbed in their natural condition where no cut, fill, driveway, or water line is allowed. The installation of the system shown gives no assurance that it will function satisfactorily and the owner remains responsible for keeping the sewage underground. If desired, the owner may contact an engineer to design a different sewage system and submit plans to the Health Department for approval.

Scale 1" = 100' Date 9-17-79 By

Thomas E. Fortner
Health Department Representative